


ASCE Manuals and Reports
on Engineering Practice No. 104

RECOMMENDED PRACTICE FOR FIBER-REINFORCED POLYMER PRODUCTS FOR OVERHEAD UTILITY LINE STRUCTURES

SECOND EDITION

Task Committee on Fiber-Reinforced
Polymer Products for Overhead
Utility Line Structures

Edited by Galen Fecht

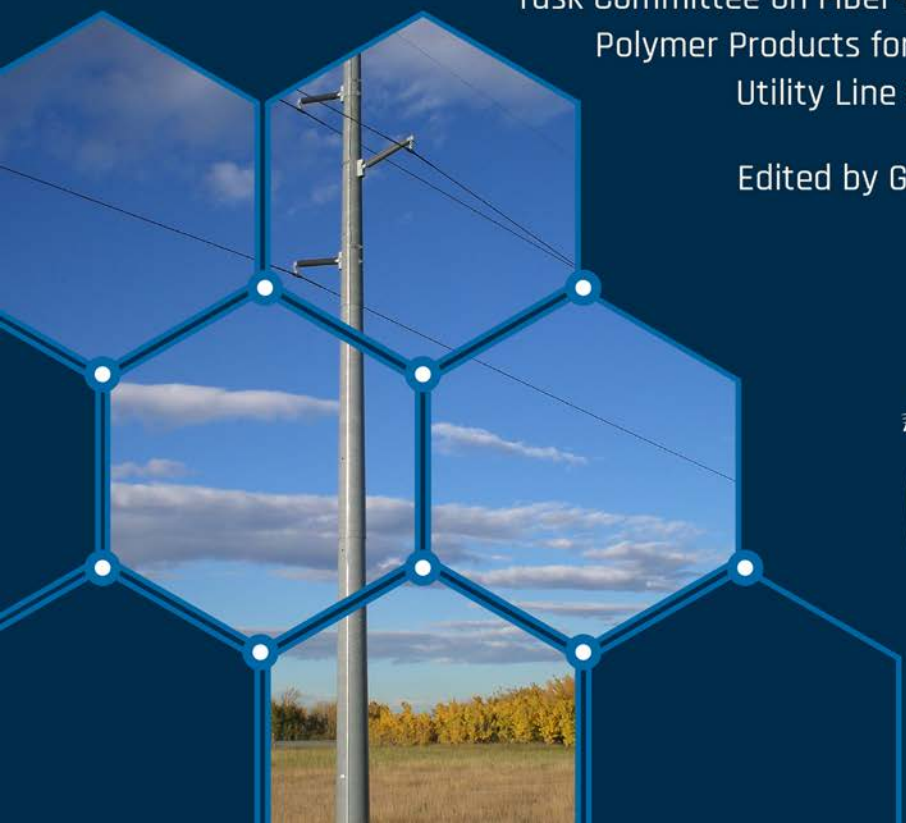

ASCE

SEI
ASCE

ASCE Manuals and Reports on Engineering Practice No. 104

Recommended Practice for Fiber-Reinforced Polymer Products for Overhead Utility Line Structures

Second Edition

Prepared by the
Task Committee on Recommended Practice for
Fiber-Reinforced Products in Overhead Utilities
Line Structures of the Structural Engineering Institute
of the American Society of Civil Engineers

ASCE AMERICAN SOCIETY OF CIVIL ENGINEERS

SEI STRUCTURAL ENGINEERING INSTITUTE

Published by the American Society of Civil Engineers

Library of Congress Cataloging-in-Publication Data

Names: American Society of Civil Engineers. Subcommittee on Recommended Practice for Fiber-Reinforced Products in Overhead Utilities Line Structures, author. | Fecht, Galen, editor.
Title: Recommended practice for fiber-reinforced polymer products for overhead utility line structures: MOP 104 / prepared by the Task Committee on Recommended Practice for Fiber-Reinforced Products in Overhead Utilities Line Structures of the Structural Engineering Institute of the American Society of Civil Engineers, edited by Galen Fecht.
Description: Second edition. | Reston, Virginia: American Society of Civil Engineers, 2019. | Includes bibliographical references and index. | Summary: "MOP 104, Second Edition, provides updated best practices and design recommendations for the use of fiber-reinforced polymer (FRP) composite poles and cross-arms in conductor support applications"—Provided by publisher.
Identifiers: LCCN 2019024894 | ISBN 9780784415443 (hardcover) | ISBN 9780784482568 (pdf)
Subjects: LCSH: Electric lines—Poles and towers—Design and construction. | Electric lines—Poles and towers—Materials. | Fiber-reinforced plastics.
Classification: LCC TK3242 .A525 2019 | DDC 621.319/22—dc23
LC record available at https://lccn.loc.gov/2019024894

Published by American Society of Civil Engineers
1801 Alexander Bell Drive
Reston, Virginia 20191-4382
www.asce.org/bookstore | ascelibrary.org

Any statements expressed in these materials are those of the individual authors and do not necessarily represent the views of ASCE, which takes no responsibility for any statement made herein. No reference made in this publication to any specific method, product, process, or service constitutes or implies an endorsement, recommendation, or warranty thereof by ASCE. The materials are for general information only and do not represent a standard of ASCE, nor are they intended as a reference in purchase specifications, contracts, regulations, statutes, or any other legal document. ASCE makes no representation or warranty of any kind, whether express or implied, concerning the accuracy, completeness, suitability, or utility of any information, apparatus, product, or process discussed in this publication, and assumes no liability therefor. The information contained in these materials should not be used without first securing competent advice with respect to its suitability for any general or specific application. Anyone utilizing such information assumes all liability arising from such use, including but not limited to infringement of any patent or patents.

ASCE and American Society of Civil Engineers—Registered in US Patent and Trademark Office.

Photocopies and permissions. Permission to photocopy or reproduce material from ASCE publications can be requested by sending an email to permissions@asce.org or by locating a title in the ASCE Library (http://ascelibrary.org) and using the "Permissions" link.

Errata: **Errata, if any, can be found at https://doi.org/10.1061/9780784415443.**

Copyright © 2019 by the American Society of Civil Engineers.
All Rights Reserved.
ISBN 978-0-7844-1544-3 (print)
ISBN 978-0-7844-8256-8 (PDF)
Manufactured in the United States of America.

25 24 23 22 21 20 19 1 2 3 4 5

MANUALS AND REPORTS ON ENGINEERING PRACTICE

(As developed by the ASCE Technical Procedures Committee, July 1930, and revised March 1935, February 1962, and April 1982)

A manual or report in this series consists of an orderly presentation of facts on a particular subject, supplemented by an analysis of limitations and applications of these facts. It contains information useful to the average engineer in his or her everyday work, rather than findings that may be useful only occasionally or rarely. It is not in any sense a "standard," however, nor is it so elementary or so conclusive as to provide a "rule of thumb" for nonengineers.

Furthermore, material in this series, in distinction from a paper (which expresses only one person's observations or opinions), is the work of a committee or group selected to assemble and express information on a specific topic. As often as practicable the committee is under the direction of one or more of the Technical Divisions and Councils, and the product evolved has been subjected to review by the Executive Committee of the Division or Council. As a step in the process of this review, proposed manuscripts are often brought before the members of the Technical Divisions and Councils for comment, which may serve as the basis for improvement. When published, each manual shows the names of the committees by which it was compiled and indicates clearly the several processes through which it has passed in review, so that its merit may be definitely understood.

In February 1962 (and revised in April 1982), the Board of Direction voted to establish a series titled "Manuals and Reports on Engineering Practice," to include the manuals published and authorized to date, future Manuals of Professional Practice, and Reports on Engineering Practice. All such manual or report material of the Society would have been refereed in a manner approved by the Board Committee on Publications and would be bound, with applicable discussion, in books similar to past manuals. Numbering would be consecutive and would be a continuation of present manual numbers. In some cases of joint committee reports, bypassing of journal publications may be authorized.

A list of available Manuals of Practice can be found at http://www.asce.org/bookstore.

CONTENTS

PREFACE ..... **xi**

1. STRUCTURES AND APPLICATIONS **1**
1.1 Introduction 1
1.2 When to Use FRP Composite Components 2
1.2.1 Where Traditional Materials Do Not Last as Long as They Should 3
1.2.2 Where Structure Installation Cost Is Higher Than Average 5
1.2.3 Where High-Performance Solutions Are Required 6
1.3 Structure Configurations 13
1.3.1 Cantilevered Structures 13
1.3.2 Framed Structures 14
1.3.3 Guyed Structures 15
1.3.4 Combined Structures 17
1.4 Applications 18
1.4.1 Transmission and Distribution Structures 18
1.4.2 Substation Structures 20
1.4.3 Lighting Supports, Highway Signs, and Traffic Signal Structures 21
1.4.4 Communication Structures 23

2. MATERIALS **25**
2.1 Introduction 25
2.2 Material Composition 25
2.2.1 Thermosets and Thermoplastics 26
2.2.2 Thermoset Polymer Resins 27
2.2.3 Additives and Fillers 27
2.2.4 Fiber Reinforcement 28

2.3 Design Criteria for Material Selection 29
2.4 FRP Material and Process Characteristics 30
2.4.1 Material Characteristics 30
2.4.2 Manufacturing Processes 31

3. DESIGN CONSIDERATIONS 37
3.1 Introduction 37
3.2 Physical Considerations 37
3.3 Transportation 37
3.4 Connections 38
3.5 Guy Wire Connections 45
3.6 Guy Wire Anchors 55
3.7 Grounding 57
3.8 Climbing 66
3.8.1 Steps 68
3.8.2 Ladders 72
3.9 Aesthetic Considerations 72
3.10 Structural Loading 73
3.10.1 Introduction 73
3.10.2 Load Considerations for Overhead Distribution and Transmission Power Lines 73
3.10.3 Legislated (or Code) Loads 74
3.10.4 Meteorological Loads 74
3.10.5 Longitudinal Loads 74
3.10.6 Construction and Maintenance Loads 75
3.10.7 Structure-Strength Equivalency 75
3.10.8 Deflection and Serviceability Equivalency 76
3.11 Durability 84
3.12 Foundations 85
3.12.1 Geotechnical Analysis 85
3.12.2 Foundation Design 85
3.13 Service Life 91
3.14 Strength 93
3.15 Electrical Performance 93
3.16 Environment 93
3.17 Life-Cycle Evaluations 94
3.18 Joints 94
3.18.1 Slip Joints 94
3.18.2 Flange and Other Mechanical Joints 96

4. DESIGN CRITERIA 97
4.1 Introduction 97
4.2 Designing with FRP Products 97
4.3 Poles 99

4.3.1 Mechanical Properties 99
4.3.2 Bending Strength 100
4.3.3 Local Buckling Strength 100
4.3.4 Axial Strength 101
4.3.5 Pull-Through Strength 101
4.3.6 Hoop Strength 102
4.3.7 Torsional Strength 102
4.3.8 Fatigue Strength 102
4.3.9 Deflection 103
4.4 Crossarms 103
4.4.1 Mechanical Properties 104
4.4.2 Bending and Shear Strength 104
4.4.3 Deflections 104

5. SUGGESTED GUIDELINES FOR PERFORMANCE-BASED TESTS 105
5.1 Introduction 105
5.2 Recommended Mechanical Tests 106
5.2.1 Static Bending (Horizontal Loading) Test 106
5.2.2 Bolt Torque Test 110
5.2.3 Bolt Pull-Through Test 111
5.2.4 Direct Load Shear Test 111
5.2.5 Field Drillability Test 111
5.2.6 Step Bolt Compatibility Test 112
5.3 Optional Mechanical Tests 112
5.3.1 Torsional Load Test 112
5.3.2 Fatigue Tests 113
5.3.3 Permanent Deflection Tests 113
5.3.4 Slip Joint Tests 114
5.3.5 Column Buckling Tests 114
5.4 Laminate Durability and Integrity Tests 114
5.4.1 Ultraviolet (UV) Radiation Tests 114
5.4.2 Hydrophobicity Tests 115
5.4.3 Water Absorption Tests 116
5.4.4 Leaching Tests 116
5.4.5 Fire Tests 116
5.4.6 Coating Tests 118
5.4.7 Impact Testing 118
5.5 Electrical Tests 119

6. QUALITY ASSURANCE 121
6.1 Introduction 121
6.2 Design and Drawings 122
6.3 Material Combination, Manufacturing Equipment, and Process 122

6.4 Material Standards Conformance 122
6.5 Tolerances 123
6.6 Surface Coatings 123
6.7 Inspection During Manufacture 123
6.8 Receiving and Shipping 124
6.9 Rejection 124
6.10 Full-Scale Structure Testing 124
6.11 Installation, Inspection, and Maintenance 125

7. ASSEMBLY AND ERECTION 127
7.1 Introduction 127
7.2 FRP Poles 127
7.2.1 Storage 127
7.2.2 Handling 128
7.2.3 Transportation 130
7.2.4 Assembly 132
7.2.5 Joint Assembly 132
7.2.6 Framing 136
7.2.7 Field Drilling 137
7.2.8 Cutting 138
7.2.9 Erection 138
7.2.10 Climbing 140
7.3 FRP Foundations 140

8. ATTACHMENTS 143
8.1 Introduction 143
8.2 Attachments 144
8.2.1 Attachment Components 144
8.2.2 Guying/Tension Attachments 145
8.2.3 FRP Guy Wire Anchor 148
8.2.4 Bearing Plate 149
8.2.5 Strap-Style Pole Band 150
8.2.6 Link-Style Pole Band 151
8.2.7 Washers 152
8.2.8 Climbing Hardware 153
8.2.9 Shield Wire Supports 154
8.2.10 Post Insulator Gain Bases (Mounting Brackets) 155
8.2.11 Base Plates 156
8.2.12 Conical Top Cap 158
8.2.13 Flat Top Cap 158
8.2.14 Rock Mounts 159
8.2.15 Pole ID Tag 160
8.2.16 Bonding/Grounding Hardware 160
8.2.17 Crossarm Mounting Brackets 162
8.3 Attachment Hardware Assemblies 163

9. IN-SERVICE CONSIDERATIONS 167
9.1 Introduction 167
9.2 Factors Influencing Performance of FRP Materials 167
9.2.1 Environment 167
9.2.2 Mechanical Fatigue 171
9.2.3 Electrical Stress and Leakage Current 171
9.3 Field Inspection 172
9.3.1 Visual Inspection 172
9.3.2 Tap Test 172
9.3.3 Other Tests 172
9.4 Repair Options 173
9.4.1 Take No Action 173
9.4.2 Repair in the Field 174
9.4.3 Component Replacement 174

Appendix A. GLOSSARY 181

Appendix B. BIBLIOGRAPHY 191

Appendix C. SUGGESTED MANUFACTURING TOLERANCES 197

Appendix D. LOADING REQUIREMENTS FOR FRC POLES UTILIZED IN OTHER THAN UTILITY LINE APPLICATIONS 199

Appendix E. COMMENTARY 201

INDEX 203

PREFACE

INTRODUCTION

Background. This manual of practice is intended to provide direction and guidance in selecting fiberglass reinforced polymer (FRP) composite utility line components, namely poles and crossarms. It covers poles and crossarms manufactured by currently available processes using FRP materials. The range of pole and crossarm applications includes distribution and transmission line structures. This book does not cover FRP lattice structures, conductors, insulators, stand-offs, or other FRP components used in the electrical grid.

The first major attempt to provide guidance to the utility industry in the selection and use of FRP utility structures was completed by the initial ASCE Task Committee on FRP Overhead Utility Line Structures. The output of that committee resulted in a document titled ASCE 104 *Recommended Practice for Fiber-Reinforced Polymer Products for Overhead Utility Line Structures*. This document was intended to introduce the subject of FRP utility line structures and serve only as a guide regarding selection and use. It was not created as a prestandard or as a standard. It also only covered pole structures and did not include crossarms. At the time it was written and published, there were very few other guides in use for FRP components, and few utility specifications had been written to include FRP poles or crossarms for utility line structures. In addition, FRP poles and crossarms were not specifically recognized by the National Electrical Safety Code (NESC) up through the NESC 2002 edition.

In this time frame, the use of FRP utility poles and crossarms was growing, even without inclusion in the NESC. However, it was clear that most utilities and cooperatives relied heavily on the NESC for direction, so it was imperative that to manage the informed growth of FRP utility poles and crossarms, recognition by NESC was necessary.

In late 2005 and early 2006, recognition by the NESC governing body that the use of FRP utility poles and crossarms had matured sufficiently to be included in the code led the NESC governing body to approve the inclusion of FRP poles and crossarms in the next edition, which was NESC 2007. Based on a long history of low coefficients of variation in product performance combined with favorable installed line performance history, the strength factors of FRP poles and crossarms were recognized in NESC 2007 to be the same as other engineered materials, namely steel and prestressed concrete.

Around the same time that composite utility poles were receiving official recognition in the NESC, similar efforts were underway in Canada. In 2006, the Canadian Standards Association (CSA) adopted composite utility poles into the CSA C22.3 No. 1, Overhead Systems standard for the first time, allowing composite utility poles to utilize the same minimum load factors as steel poles, providing that the composite pole manufacturers rated their pole strengths as 5% lower exclusion limit (LEL) values and through ongoing testing could verify a coefficient of variation (COV) of 10% or less for their product. In addition, the Center for Energy Advancement through Technological Innovation (CEATI) International Inc. hired a consultant to develop the *Guide for the Use of Composite Poles, Crossarms and Braces* for the major Canadian and US utilities that are members of CEATI.

Task Committee History. In 2006, following the acceptance of FRP utility poles and crossarms into the soon-to-be-published NESC 2007, there was still no US publication available for use by the utility industry to ensure appropriate standardized pole and crossarm design, manufacture, and performance. Therefore, in mid-2006, it was determined that a new task committee effort needed to be organized with the purpose of generating a document for the design, selection, purchase, and installation of FRP overhead utility line structures.

This need culminated in the organization of an ASCE Task Committee for FRP Overhead Utility Structures as of October 1, 2006, with the first meeting held in Birmingham, Alabama, on October 19, 2006. This committee was organized under the Electrical Transmission Structures (ETS) Committee of ASCE.

The efforts of the 2006 FRP committee resulted in a near-complete document on November 5, 2008; however, the document was neither reviewed nor published. In 2013, the FRP committee was reinstated with the first meeting held in Boston, Massachusetts, on April 3, 2014.

USE OF THIS MANUAL

Many references in this Manual of Practice (MOP) advise the user to consult with FRP component manufacturers. Although this MOP has been

authored with the intent of covering the generalities of FRP component consideration and usage, because of the variety of input materials, manufacturing methods, and resulting finished goods, a necessary step in working with a given FRP component is consulting with that component's manufacturer to confirm its attributes and allowable stress limits. Furthermore, once these characteristics are known and understood, the specific FRP component can be integrated into a utility's existing overhead line design standards, where a manufacturer's input may only be required for deviations from the established design standard.

CHAPTER 1
STRUCTURES AND APPLICATIONS

1.1 INTRODUCTION

Fiber-reinforced polymer (FRP) utility structures are not new to the electric power industry, nor is the use of FRP materials. Many products used by the industry are made of or incorporate FRP materials, including poles, ladders, grating, construction tools, lift-truck booms, transformer pads, hot sticks, bus bar supports, insulators, pole line hardware, and crossarms. Lighting poles made entirely of FRP materials have been used for decades; by the late 1990s, installations of FRP lighting poles numbered in the millions. Also by that time, electric utilities had installed a growing number of FRP poles designed to support power and telecommunication lines. The earliest FRP distribution poles were installed in Hawaii on the island of Maui in the mid 1960s. These first-generation FRP poles withstood high UV exposure, a corrosive island environment, and strong winds and performed reliably for approximately 45 years. Current FRP poles have vastly improved UV-protection systems over first-generation FRP pole offerings, which has provided great improvements in service life.

FRP materials are used widely in many applications because they can be engineered to offer important advantages over traditional materials. Such advantages include excellent reliability in high-load events, a high strength-to-weight ratio (lightweight), low maintenance, electromagnetic interference (EMI) and radio frequency (RF) transparency, dimensional stability, high dielectric strength/safety, fire resistance, environmental stability (inert, nonleaching material), and resistance to rot, corrosion, chemicals, and pest damage. Good examples of these benefits are cellular communications system enclosures on buildings (lightweight, RF transparency); fencing, handrail, and stair systems for hotel buildings/industrial complexes/offshore platforms

(rot/rust resistance, low maintenance); grating, handrails, and structural platforms in copper-processing plants and wastewater treatment facilities (rust/chemical resistance, low maintenance, easy installation); third-rail cover boards and grating for metropolitan light transit systems (high dielectric strength/safety, rot/rust resistance); structural framework for field-erected cooling towers (high strength-to-weight ratio, rot resistance, easy installation); and grating and handrails for offshore oil drilling platforms (lightweight, rust resistance, low maintenance). The list of benefits goes on and on for the users of FRP products.

FRP materials also offer product engineers extraordinary design latitude. Engineers can choose from a wide range of material systems and processing techniques. This degree of flexibility distinguishes FRP materials from traditional materials like wood, steel, and concrete. The benefits and limitations of a finished FRP product largely depend on the material composition, the selected manufacturing process, and the relationship between the two. In fact, the relationship between materials and process is a more significant consideration with FRP products than with products made of traditional materials. The design flexibility, light weight, and durability of FRP materials is the reason FRP bridge decks are replacing concrete bridge decks on some vehicular bridges such as lift bridges, truss bridges, and other structures where weight, durability, and speed of installation are very important. Additionally, FRP materials' unique benefits have resulted in FRP rebar and FRP grating panels replacing steel rebar for reinforcing concrete bridge decks. The design flexibility of FRP products also applies to transmission structures and poles. Unlike poles made from traditional materials, FRP poles are available in a wide range of geometric shapes, colors, and surface textures, which provide additional solutions to asset owners.

Advancements and innovations in FRP materials and process technologies have resulted in lightweight, high-strength FRP materials that are more cost-competitive with traditional construction materials such as wood, steel, and prestressed concrete. While there are a variety of possible structural applications for FRP materials, this document focuses primarily on FRP poles and crossarms.

1.2 WHEN TO USE FRP COMPOSITE COMPONENTS

The power utility grid covers almost every corner of the earth and, as such, must endure many challenges—from initial construction hurdles, including topography and ground conditions, to in-service issues, including everything from extreme weather such as ice storms and hurricanes to everyday conditions such as salt environments near oceans or ice control on winter roads. Even woodpeckers and soil pH levels need to be considered in a hardened grid strategy.