IEC 60695-6-1

Edition 3.0 2021-08
REDLINE VERSION

INTERNATIONAL STANDARD

colour inside

HORIZONTAL PUBLICATION

Fire hazard testing –
Part 6-1: Smoke obscuration – General guidance



IEC 60695-6-1:2021-08 RLV(en)



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2021 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembé
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC
The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications
The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform
The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, …). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished
Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc
If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC online collection - oc.iec.ch
Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org
The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 18 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC 60695-6-1

Edition 3.0 2021-08
REDLINE VERSION

INTERNATIONAL STANDARD

colour inside

HORIZONTAL PUBLICATION

Fire hazard testing –
Part 6-1: Smoke obscuration – General guidance

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 13.220.99; 29.020

ISBN 978-2-8322-1013-1

Warning! Make sure that you obtained this publication from an authorized distributor.

® Registered trademark of the International Electrotechnical Commission

CONTENTS

FOREWORD....4
INTRODUCTION....2
1 Scope....8
2 Normative references....8
3 Terms, definitions and symbols....9
3.1 Terms and definitions....9
3.2 Symbols....9
4 General aspects of smoke test methods....14
4.1 Fire scenarios and physical fire models....14
4.2 Factors affecting smoke production....15
4.2.1 General....15
4.2.2 Modes of decomposition....16
4.2.3 Ventilation and the burning environment....19
4.2.4 Time and temperature....19
4.2.5 Removal mechanisms for smoke particles....19
5 Principles of smoke measurement....19
5.1 General....19
5.2 Bouguer's law....19
5.3 Extinction area....20
5.4 Log_{10} units....21
5.5 Light sources....21
5.6 *Specific extinction area of smoke*....21
5.7 *Mass optical density of smoke*....22
5.8 *Visibility*....23
6 Static and dynamic methods....23
6.1 Static methods....23
6.1.1 Principles....23
6.1.2 *Extinction area of smoke*....23
6.1.3 *Specific optical density of smoke*....24
6.1.4 Prediction of *visibility*....24
6.2 Dynamic methods....24
6.2.1 Principles....24
6.2.2 Smoke production rate....24
6.2.3 Total smoke production....25
6.2.4 SMOGRA index....25
7 Test methods....26
7.1 Consideration of test methods....26
7.2 Selection of test specimen....27
8 Presentation of data....27
9 Relevance of data to hazard assessment....27
Annex A (informative) Calculation of *visibility*....30
A.1 General....30
A.2 Example....30
Annex B (informative) Relationships between D_S and some other smoke parameters as measured in ~~IEC 60695-6-30 and IEC 60695-6-31~~ ISO 5659-2 [4]....32

Annex C (informative) Relationships between per cent transmission, as measured in a "three metre cube" enclosure, and extinction area 34
Bibliography 36

Figure 1 – Different phases in the development of a fire within a compartment 15
Figure 2 – Attenuation of light by smoke 20
Figure 3 – Extinction area 21
Figure 4 – Dynamic smoke measurement 24
Figure 5 – Example SPR_{av} versus t curve 26
Figure 6 – *SMOGRA* curve derived from Figure 5 26
Figure 7 – Evaluation and consideration of smoke test methods 29
Figure A.1 – *Visibility* (ω) versus *extinction coefficient* (k) 30
Figure B.1 – Smoke parameters related to D_S as measured in ~~IEC 60695-6-30 and IEC 60695-6-31~~ ISO 5659-2 33
Figure C.1 – Extinction area (amount of smoke) related to per cent transmission as measured in the "three metre cube" 35

Table 1 – Characteristics of fire stages (from Table 1 in ISO 19706:2011) 17
Table B.1 – Conversion from D_s to some other smoke parameters as measured in ~~IEC 60695-6-30 and IEC 60695-6-31~~ ISO 5659-2 32
Table C.1 – Conversions from per cent transmission, as measured in the "three metre cube" to amount of smoke (extinction area) 34

INTERNATIONAL ELECTROTECHNICAL COMMISSION

_____

FIRE HAZARD TESTING –

Part 6-1: Smoke obscuration – General guidance

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition IEC 60695-6-1:2005+AMD1:2010 CSV. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

International Standard IEC 60695-6-1 has been prepared by IEC technical committee 89: Fire hazard testing.

This third edition cancels and replaces the second edition of IEC 60695-6-1 published in 2005 and Amendment 1:2010. It constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

– References to IEC TS 60695-6-30 (withdrawn in 2016) have been removed.
– References to IEC TS 60695-6-31 (withdrawn in 2016) have been removed.
– References to ISO 5659-2 have been inserted.
– The scope contains some additional text.
– Terms and definitions have been updated.
– Subclause 3.2 has been updated.
– Subclause 7.1 has been updated.

The text of this International Standard is based on the following documents:

Draft	Report on voting
89/1472/CDV	89/1504/RVC

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

It has the status of a basic safety publication in accordance with IEC Guide 104 and ISO/IEC Guide 51.

This International Standard is to be used in conjunction with IEC 60695-6-2.

In this standard, the following print types are used:

- *italic font: terms defined in Clause 3.*

A list of all parts in the IEC 60695 series, published under the general title *Fire hazard testing*, can be found on the IEC website.

IEC 60695-6 consists of the following parts:

Part 6-1: Smoke obscuration – General guidance

Part 6-2: Smoke obscuration – Summary and relevance of test methods

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/standardsdev/publications.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

~~The risk of fire needs to be considered in any electrical circuit, and the objective of component, circuit and equipment design, as well as the choice of material, is to reduce the likelihood of fire, even in the event of foreseeable abnormal use, malfunction or failure.~~

~~Electrotechnical products, primarily victims of a fire, may nevertheless contribute to the fire.~~

In the design of an electrotechnical product the risk of fire and the potential hazards associated with fire need to be considered. In this respect the objective of component, circuit and equipment design, as well as the choice of materials, is to reduce the risk of fire to a tolerable level even in the event of reasonably foreseeable (mis)use, malfunction or failure.

IEC 60695-1-10, IEC 60695-1-11, and IEC 60695-1-12 [1][1] provide guidance on how this is to be accomplished.

Fires involving electrotechnical products can also be initiated from external non-electrical sources. Considerations of this nature are dealt with in an overall fire hazard assessment.

The aim of the IEC 60695 series is to save lives and property by reducing the number of fires or reducing the consequences of the fire. This can be accomplished by:

– trying to prevent ignition caused by an electrically energised component part and, in the event of ignition, to confine any resulting fire within the bounds of the enclosure of the electrotechnical product.
– trying to minimise flame spread beyond the product's enclosure and to minimise the harmful effects of fire effluents including heat, *smoke*, and toxic or corrosive combustion products.

One of the contributing hazards is the release of *smoke*, which may cause loss of vision and/or disorientation which could impede escape from the building or fire fighting.

Smoke particles reduce the *visibility* due to light absorption and scattering. Consequently, people may experience difficulties in finding exit signs, doors and windows. *Visibility* is often determined as the distance at which an object is no longer visible. It depends on many factors, but close relationships have been established between *visibility* and the measurements of the *extinction coefficient of smoke* – see Annex A.

The production of *smoke* and its optical properties can be measured as well as other fire properties, such as heat release, flame spread, and the production of toxic gas and corrosive effluent. This document serves as a guidance document and focuses on obscuration of light by *smoke*.

[1] Numbers in square brackets refer to the bibliography.

FIRE HAZARD TESTING –

Part 6-1: Smoke obscuration – General guidance

1 Scope

This part of IEC 60695 gives guidance on:

a) the optical measurement of *obscuration of smoke*;

b) general aspects of optical *smoke* test methods;

c) consideration of test methods;

d) expression of *smoke* test data;

e) the relevance of optical *smoke* data to hazard assessment.

This basic safety publication focusing on safety guidance is primarily intended for use by technical committees in the preparation of safety publications in accordance with the principles laid down in IEC Guide 104 and ISO/IEC Guide 51.

One of the responsibilities of a technical committee is, wherever applicable, to make use of basic safety publications in the preparation of its publications.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60695-1-10, *Fire hazard testing – Part 1-10: Guidance for assessing the fire hazard of electrotechnical products – General guidelines*

IEC 60695-1-11~~[2]~~, *Fire hazard testing – Part 1-11: Guidance for assessing the fire hazard of electrotechnical products – Fire hazard assessment*

IEC 60695-4~~:2005~~, *Fire hazard testing – Part 4: Terminology concerning fire tests for electrotechnical products*

IEC 60695-6-2~~[3]~~, *Fire hazard testing – Part 6-2: Smoke obscuration – Summary and relevance of test methods*

~~*IEC 60695-6-30:1996, Fire hazard testing – Part 6: Guidance and test methods on the assessment of obscuration hazard of vision caused by smoke opacity from electrotechnical products involved in fires – Section 30: Small-scale static method – Determination of smoke opacity – Description of the apparatus*~~

~~*IEC 60695-6-31:1999, Fire hazard testing – Part 6-31: Smoke obscuration – Small-scale static test – Materials*~~

_____

~~[2] To be published.~~

~~[3] To be published.~~

IEC Guide 104~~:1997~~, *The preparation of safety publications and the use of basic safety publications and group safety publications*

ISO/IEC Guide 51~~:1999~~*, Safety aspects – Guidelines for their inclusion in standards*

~~ISO 5659-2:2006, *Plastics – Smoke generation – Part 2: Determination of optical density by a single-chamber test*~~

~~ISO 5660-2:2002, *Reaction-to-fire tests – Heat release, smoke production and mass loss rate – Part 2: Smoke production rate (dynamic measurement)*~~

ISO 13943:~~2008~~2017, *Fire safety – Vocabulary*

~~ISO 19706:2007, *Guidelines for assessing the fire threat to people*~~

~~NOTE ISO 9122-1:1989, *Toxicity testing of fire effluents – Part 1: General*, has been withdrawn and replaced by ISO 19706:2007.~~

~~ASTM E 1354:2008, *Standard Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using an Oxygen Consumption Calorimeter*~~

~~EN 13823:2002, *Reaction to fire tests for building products – Building products, excluding floorings, exposed to thermal attack by a single burning item*~~

3 Terms, definitions and symbols

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO~~/IEC~~ 13943:2017 and IEC 60695-4, some of which are reproduced below, apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at http://www.electropedia.org/
- ISO Online browsing platform: available at http://www.iso.org/obp

~~**3.1.1**~~
~~**combustion**~~
~~exothermic reaction of a substance with an oxidizing agent~~

~~NOTE Combustion generally emits fire effluent accompanied by flames and/or glowing.~~

~~[ISO/IEC 13943, definition 4.46]~~

~~**3.1.4**~~
~~**fire**~~
~~⟨general⟩ process of combustion characterized by the emission of heat and fire effluent and usually accompanied by smoke, flame or glowing or a combination thereof~~

~~NOTE In the English language the term "fire" is used to designate three concepts, two of which, fire (3.1.5) and fire (3.1.6), relate to specific types of self-supporting combustion with different meanings and two of them are designated using two different terms in both French and German.~~

~~[ISO/IEC 13943, definition 4.96]~~

~~**3.1.5**~~
~~**fire**~~
~~⟨controlled⟩ self-supporting combustion that has been deliberately arranged to provide useful effects and is limited in its extent in time and space~~

~~[ISO/IEC 13943, definition 4.97]~~

~~**3.1.6**~~
~~**fire**~~
~~⟨uncontrolled⟩ self-supporting combustion that has not been deliberately arranged to provide useful effects and is not limited in its extent in time and space~~

~~[ISO/IEC 13943, definition 4.98]~~

~~**3.1.7**~~
~~**fire effluent**~~
~~totality of gases and aerosols, including suspended particles, created by combustion or pyrolysis in a fire~~

~~[ISO/IEC 13943, definition 4.105]~~

~~**3.1.8**~~
~~**fire hazard**~~
~~physical object or condition with a potential for an undesirable consequence from fire~~

~~[ISO/IEC 13943, definition 4.112]~~

~~**3.1.9**~~
~~**fire model**~~
~~**fire simulation**~~
~~calculation method that describes a system or process related to fire development, including fire dynamics and the effects of fire~~

~~[ISO/IEC 13943, definition 4.116]~~

~~**3.1.10**~~
~~**fire scenario**~~
~~qualitative description of the course of a fire with respect to time, identifying key events that characterise the studied fire and differentiate it from other possible fires~~

~~NOTE It typically defines the ignition and fire growth processes, the fully developed fire stage, the fire decay stage, and the environment and systems that impact on the course of the fire.~~

~~[ISO/IEC 13943, definition 4.129]~~

~~**3.1.11**~~
~~**flashover**~~
~~⟨stage of fire⟩ transition to a state of total surface involvement in a fire of combustible materials within an enclosure~~

~~[ISO/IEC 13943, definition 4.156]~~

~~**3.1.12**~~
~~**heat flux**~~
~~amount of thermal energy emitted, transmitted or received per unit area and per unit time~~

~~NOTE The typical units are watts per square metre ($W \cdot m^{-2}$).~~

~~[ISO/IEC 13943, definition 4.173]~~

~~**3.1.13**~~
~~**ignition**~~
~~sustained ignition (deprecated)~~

~~⟨general⟩ initiation of combustion~~

~~[ISO/IEC 13943, definition 4.187]~~

~~**3.1.14**~~
~~**ignition**~~
~~sustained ignition (deprecated)~~

~~⟨flaming combustion⟩ initiation of sustained flame~~

~~[ISO/IEC 13943, definition 4.188]~~

~~**3.1.15**~~
~~**large-scale fire test**~~
~~fire test, that cannot be carried out in a typical laboratory chamber, performed on a test specimen of large dimensions~~

~~NOTE A fire test performed on a test specimen of which the maximum dimension is greater than 3 m is usually called a large-scale fire test.~~

~~[ISO/IEC 13943, definition 4.205]~~

~~**3.1.20**~~
~~**real-scale fire test**~~
~~fire test that simulates a given application, taking into account the real scale, the real way the item is installed and used, and the environment~~

~~NOTE Such a fire test normally assumes that the products are used in accordance with the conditions laid down by the specifier and/or in accordance with normal practice.~~

~~[ISO/IEC 13943, definition 4.273]~~

~~**3.1.21**~~
~~**small-scale fire test**~~
~~fire test performed on a test specimen of small dimensions~~

~~NOTE A fire test performed on a test specimen of which the maximum dimension is less than 1 m is usually called a small-scale fire test.~~

~~[ISO/IEC 13943, definition 4.292]~~

3.1.1
extinction area of smoke
product of the volume occupied by *smoke* (3.1.10) and the *extinction coefficient* (3.1.2) of the smoke

Note 1 to entry: The extinction area of smoke is a measure of the amount of smoke. The typical unit is m^2.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.92~~ 3.110]

3.1.2
extinction coefficient
natural logarithm of the ratio of incident light intensity to transmitted light intensity, per unit light path length

Note 1 to entry: The typical unit is m^{-1}.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.93~~ 3.111]

3.1.3
mass optical density of smoke
~~optical density of smoke multiplied by a factor, $V/(\Delta m\ L)$, where V is the volume of the test chamber, Δm is the mass lost from the test specimen, and L is the light path length~~

optical density of smoke (3.1.6) multiplied by a factor which is the volume of the test chamber divided by the product of the mass lost from the test specimen and the light path length

Note 1 to entry: The typical unit is $m^2 \cdot g^{-1}$.

Note 2 to entry: Optical density of smoke = $V/(\Delta m\ L)$, where V is test chamber volume, Δm is test specimen mass loss and L is light path length.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.225~~ 3.265]

3.1.4
obscuration ~~by~~ of smoke
reduction in the intensity of light due to its passage through *smoke* (3.1.10)

~~cf. **extinction area of smoke** (3.1.2) and **specific extinction area of smoke** (3.1.26).~~

Note 1 to entry: Compare with the terms *extinction area of smoke* (3.1.1), *extinction coefficient* (3.1.2), *opacity of smoke* (3.1.5), *optical density of smoke* (3.1.6), *smoke obscuration* (3.1.11), *specific extinction area of smoke* (3.1.13) and *specific optical density of smoke* (3.1.14).

Note 2 to entry: In practice, obscuration ~~by~~ of smoke is usually measured as the transmittance which is normally expressed as a percentage.

Note 3 to entry: The obscuration ~~by~~ of smoke causes a reduction in *visibility* (3.1.6).

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.242~~ 3.286]

3.1.5
opacity of smoke
ratio of incident light intensity to transmitted light intensity through *smoke* (3.1.10), under specified conditions

~~cf. **obscuration by smoke** (3.1.17)~~

Note 1 to entry: Also, *obscuration of smoke* (3.1.4), *smoke obscuration* (3.1.11).

Note 2 to entry: The opacity of smoke is the reciprocal of transmittance.

Note 3 to entry: The opacity of smoke is dimensionless.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.243~~ 3.287]

3.1.6
optical density of smoke
measure of the attenuation of a light beam passing through *smoke* (3.1.10) expressed as the logarithm to the base 10 of the *opacity of smoke* (3.1.5)

Note 1 to entry: Compare with the term *specific optical density of smoke* (3.1.14).

Note 2 to entry: The optical density of smoke is dimensionless.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.244~~ 3.288]

3.1.7
physical fire model
laboratory process, including the apparatus, the environment and the fire test procedure intended to represent a certain phase of a fire

[SOURCE: ISO 13943:2017, 3.298]

3.1.8
SMOGRA
smoke growth rate parameter that is a function of the rate of smoke production and the time of smoke production

Note 1 to entry: Further details are given in 6.2.4.

3.1.9
SMOGRA index
maximum value of *SMOGRA* (3.1.8) during a defined test period

Note 1 to entry: Further details are given in 6.2.4.

3.1.10
smoke
visible part of a fire effluent

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.293~~ 3.347]

3.1.11
smoke obscuration
reduction of light transmission by *smoke* (3.1.10), as measured by light attenuation

Note 1 to entry: Compare with the terms *extinction area of smoke* (3.1.1), *extinction coefficient* (3.1.2), *obscuration of smoke* (3.1.4), *opacity of smoke* (3.1.5), *optical density of smoke* (3.1.6), *specific extinction area of smoke* (3.1.13) and *specific optical density of smoke* (3.1.14).

[SOURCE: ISO 13943:2017, 3.349]

3.1.12
smoke production rate
amount of *smoke* (3.1.10) produced per unit time in a fire or fire test

Note 1 to entry: The smoke production rate is calculated as the product of the volumetric flow rate of *smoke* (3.1.10) and the *extinction coefficient* (3.1.2) of the smoke at the point of measurement.

Note 2 to entry: The typical unit is $m^2 \cdot s^{-1}$.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.295~~ 3.351]

3.1.13
specific extinction area of smoke
extinction area of smoke (3.1.1) produced by a test specimen in a given time period divided by the mass lost from the test specimen in the same time period

Note 1 to entry: The typical unit is $m^2 \cdot g^{-1}$.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.301~~ 3.358]

3.1.14
specific optical density of smoke
optical density of smoke (3.1.6) multiplied by a geometric factor

Note 1 to entry: The geometric factor is ~~equal to~~ $V/(A \cdot L)$, where V is the volume of the test chamber, A is the area of the exposed surface of the test specimen, and L is the light path length.

Note 2 to entry: The use of the term "specific" does not denote "per unit mass" but rather denotes a quantity associated with a particular test apparatus and area of the exposed surface of the test specimen.

Note 3 to entry: The specific optical density of smoke is dimensionless.

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.303~~ 3.360]

3.1.15
visibility
maximum distance at which an object of defined size, brightness and contrast can be seen and recognized

[SOURCE: ISO ~~/IEC~~ 13943:2017, ~~definition 4.350~~ 3.420]

3.2 Symbols

Symbol	Quantity	Typical units
A	exposed area of test specimen	m^2
D	linear decadic absorption coefficient (commonly called optical density per metre)	m^{-1}
D'	*optical density of smoke*	dimensionless
D_{mass}	*mass optical density of smoke*	$m^2\ kg^{-1}$
D_s	*specific optical density of smoke*	dimensionless
D_{max} (also D_m)	maximum *specific optical density of smoke*	dimensionless
I	intensity of incident light	~~W~~ cd
I/T	*opacity of smoke* (ratio of incident light to transmitted light)	dimensionless
k	linear Napierian absorption coefficient (commonly called *extinction coefficient*)	m^{-1}
L	light path length through *smoke*	m
Δm	mass loss of test specimen	kg
$\dot{m}$	mass loss rate	$kg\ s^{-1}$
S	*extinction area of smoke (also total smoke)*	m^2
$\dot{S}$	*smoke production rate* (rate of change of extinction area)	$m^2\ s^{-1}$
t	time	s
Δt	sampling time interval	s
T	intensity of transmitted light	~~W~~ cd
V	volume of chamber	m^3
$\dot{V}$	volume flow rate of *smoke*	$m^3\ s^{-1}$
σ_f	*specific extinction area of smoke*	$m^2\ kg^{-1}$
γ	a constant of proportionality between *visibility* and *extinction coefficient*	dimensionless
ω	*visibility*	m

NOTE 1 The quantities based on $\log_{10}$, i.e. D, D', D_{max}, D_{mass} and D_s, have similar symbols but they are different quantities and have different units.

NOTE 2 The use of the term "specific" in the case of *specific optical density of smoke*, D_s, does not denote "per unit mass".

4 General aspects of smoke test methods

4.1 Fire scenarios and physical fire models

During recent years, major advances have been made in the analysis of fire effluents. It is recognized that the composition of the mixture of combustion products is particularly dependent upon the nature of the combusting materials, the prevailing temperatures and ventilation conditions, especially access of oxygen to the seat of the fire. Table 1 shows how the different types of fire relate to the changing atmosphere. Conditions for use in laboratory tests (small or large-scale) can be derived from the table in order to correspond, as far as possible, to real-scale fires.

Fire involves a complex and interrelated array of physical and chemical phenomena. As a result, it is difficult to simulate all aspects of a real-scale fire in a smaller scale apparatus. This problem of *physical fire model* validity is perhaps the single most perplexing technical problem associated with all fire testing.

General guidance for assessing the fire hazard of electrotechnical products is given in IEC 60695-1-10 and IEC 60695-1-11.

After ignition, fire development may occur in different ways depending on the environmental conditions, as well as on the physical arrangement of the combustible materials. However, a general pattern can be established for fire development within a compartment, where the general temperature-time curve shows three stages, plus a decay stage (see Figure 1).

Stage 1 is the incipient stage of the fire prior to sustained flaming, with little rise in the fire room temperature. Ignition and *smoke* generation are the main hazards during this stage. Stage 2 (developing fire) starts with ignition and ends with an exponential rise in the fire room temperature. Spread of flame and heat release are the main hazards in addition to *smoke* during this stage. Stage 3 (fully developed fire) starts when the surface of all of the combustible contents of the room has decomposed to such an extent that sudden ignition occurs all over the room, with a rapid and large increase in temperature (flash-over).

At the end of stage 3, the combustibles and/or oxygen have been largely consumed and hence the temperature decreases at a rate which depends on the ventilation and the heat and mass transfer characteristics of the system. This is known as decay.

In each of these stages, a different mixture of decomposition products may be formed and this, in turn, influences the *smoke* ~~density~~ produced during that stage. ~~Moreover~~ In order to select an appropriate fire test, information is required on the fire scenario being considered, in particular the conditions of incident heat flux, oxygen availability and the facilities for venting the *smoke*.

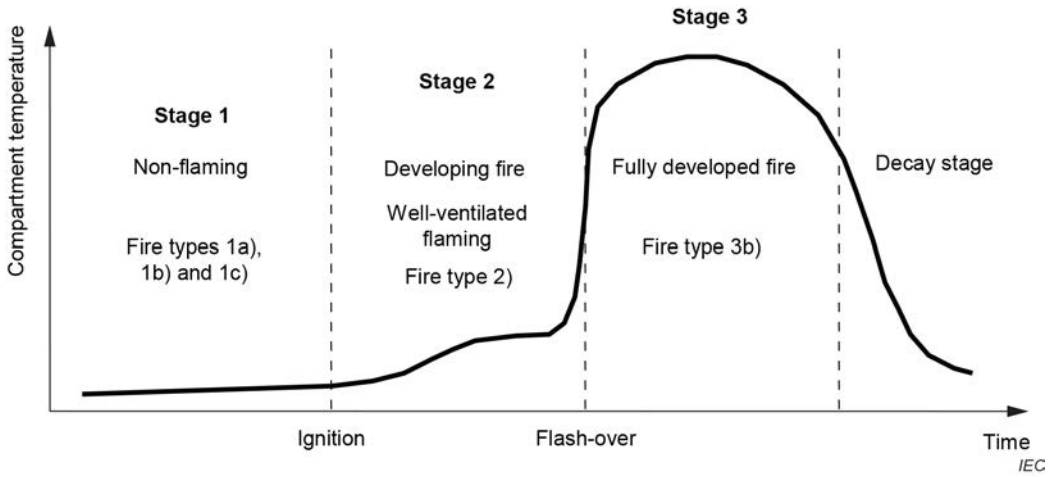


Figure 1 – Different phases in the development of a fire within a compartment

4.2 Factors affecting smoke production

4.2.1 General

Many factors affect the production of *smoke* and the properties of *smoke*. A full description of such properties is not possible, but the influence of several important variables is recognized.