IEC 62386-220

Edition 1.0 2019-01

INTERNATIONAL STANDARD

NORME INTERNATIONALE

colour inside

Digital addressable lighting interface – Part 220: Particular requirements for control gear – Centrally supplied emergency operation (device type 19)

Interface d'éclairage adressable numérique – Partie 220: Exigences particulières pour les appareillages de commande – Fonctionnement de secours alimenté par source centrale (dispositifs de type 19)



IEC 62386-220:2019-01(en-fr)



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2019 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembé
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC
The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications
The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform
The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,…). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished
Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc
If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org
The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary
67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

A propos de l'IEC
La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC
Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC - webstore.iec.ch/advsearchform
La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,…). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished
Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc
Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

Electropedia - www.electropedia.org
Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary
67 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

IEC 62386-220

Edition 1.0 2019-01

INTERNATIONAL STANDARD

NORME INTERNATIONALE

colour inside

Digital addressable lighting interface – Part 220: Particular requirements for control gear – Centrally supplied emergency operation (device type 19)

Interface d'éclairage adressable numérique – Partie 220: Exigences particulières pour les appareillages de commande – Fonctionnement de secours alimenté par source centrale (dispositifs de type 19)

INTERNATIONAL ELECTROTECHNICAL COMMISSION

COMMISSION ELECTROTECHNIQUE INTERNATIONALE

ICS 29.140.50; 29.140.99

ISBN 78-2-8322-6459-1

Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.

® Registered trademark of the International Electrotechnical Commission
Marque déposée de la Commission Electrotechnique Internationale

CONTENTS

FOREWORD 4
INTRODUCTION 6
1 Scope 8
2 Normative references 8
3 Terms and definitions 8
4 General 9
4.1 General 9
4.2 Version number 10
4.3 External power supply of bus units 10
4.4 Power interruption at bus units 10
4.4.1 General 10
4.4.2 Power interruptions of external power supply 10
5 Electrical specification 10
5.1 General 10
5.2 Marking of the supply interface 10
6 Interface power supply 11
7 Transmission protocol structure 11
8 Timing 11
9 Method of operation 11
9.1 General 11
9.2 Purpose of control gear in central emergency system 11
9.3 Emergency operation light output and emergency level 11
9.4 Detection of supply type 11
9.5 Emergency condition 11
9.6 System failure versus emergency system failure 12
9.7 Emergency mode 12
9.7.1 Activating emergency mode 12
9.7.2 Light output transition time in emergency mode 13
9.7.3 Response during emergency mode 13
9.7.4 Leaving emergency mode 13
9.7.5 Protection functionalities in emergency mode 14
9.7.6 Configuring emergency mode variables 14
9.7.7 Emergency mode and operating modes 15
9.8 Emergency physical maximum level 15
9.9 Testing of emergency level 15
9.10 Emergency status 15
9.11 Data integrity and consistency 16
9.11.1 General 16
9.11.2 Finite locking 16
9.11.3 Infinite locking 17
9.12 Restricting device type support 17
10 Declaration of variables 17
11 Definition of commands 18
11.1 General 18
11.2 Overview sheets 18
11.3 Queries 20

11.3.1 General 20
11.3.2 QUERY ACTUAL LEVEL 20
11.4 Application extended commands 20
11.4.1 General 20
11.4.2 Configuration instructions 20
11.4.3 Level instructions 21
11.4.4 Queries 21
11.5 Special commands 22
11.5.1 General 22
11.5.2 ENABLE DEVICE TYPE (*data*) 22
Annex A (informative) Recommendations and annotations for emergency luminaires and emergency lighting systems 23
A.1 Recommendations regarding emergency luminaires 23
A.2 Recommendations regarding emergency lighting systems 23
A.3 Switchover timing for emergency lighting systems 23
Bibliography 25

Figure 1 – IEC 62386 graphical overview 6
Figure 2 – Example of an external power interruption 10
Figure A.1 – Overall switching time in emergency lighting system according to EN 50171 changeover mode 24
Figure A.2 – Overall switching time in centrally supplied emergency lighting system with emergency condition being bus power down 24

Table 1 – Emergency condition and emergency mode 12
Table 2 – Response on interruptions of bus power 12
Table 3 – Response when leaving emergency mode 14
Table 4 – Emergency status 15
Table 5 – Declaration of additional variables 17
Table 6 – Application extended commands for this device type 19

INTERNATIONAL ELECTROTECHNICAL COMMISSION

_____

DIGITAL ADDRESSABLE LIGHTING INTERFACE –

Part 220: Particular requirements for control gear – Centrally supplied emergency operation (device type 19)

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62386-220 has been prepared by IEC technical committee 34: Lamps and related equipment.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
34/577/FDIS	34/591/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

This Part 220 of IEC 62386 is intended to be used in conjunction with:

- Part 101, which contains general requirements for system components;
- Part 102, which contains general requirements for control gear.

A list of all parts in the IEC 62386 series, published under the general title *Digital addressable lighting interface*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "http://webstore.iec.ch" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

IEC 62386 contains several parts, referred to as series. The 1xx series includes the basic specifications. Part 101 contains general requirements for system components, Part 102 extends this information with general requirements for control gear and Part 103 extends it further with general requirements for control devices.

The 2xx parts extend the general requirements for control gear with lamp specific extensions (mainly for backward compatibility with Edition 1 of IEC 62386) and with control gear specific features.

The 3xx parts extend the general requirements for control devices with input device specific extensions describing the instance types as well as some common features that can be combined with multiple instance types.

This first edition of IEC 62386-220 is intended to be used in conjunction with IEC 62386-101:2014, IEC 62386-101:2014/AMD1:2018, IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018 and with the various parts that make up the IEC 62386-2xx series for control gear. The division into separately published parts provides for ease of future amendments and revisions. Additional requirements will be added as and when a need for them is recognised.

The setup of the standards is graphically represented in Figure 1 below.

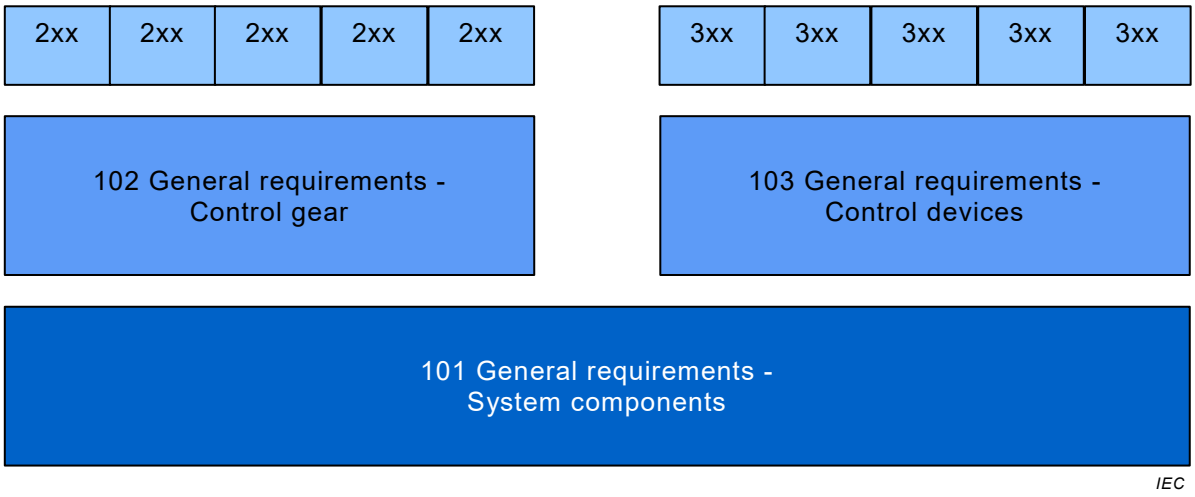


Figure 1 – IEC 62386 graphical overview

This document, and the other parts that make up the IEC 62386-200 series, in referring to any of the clauses of IEC 62386-1XX, specifies the extent to which such a clause is applicable; the parts also include additional requirements, as necessary.

Where the requirements of any of the clauses of IEC 62386-1XX are referred to in this document by the sentence "The requirements of IEC 62386-1XX, Clause "n" apply", this sentence is to be interpreted as meaning that all requirements of the clause in question of Part 1XX apply, except any which are clearly inapplicable.

The standardization of the control interface for control gear is intended to achieve compatible co-existence between electronic control gear and lighting control devices, below the level of building management systems. This document describes a method of implementing control gear.

All numbers used in this document are decimal numbers unless otherwise noted.Hexadecimal numbers are given in the format 0xVV, where VV is the value. Binary numbers are given in the format XXXXXXXXb or in the format XXXX XXXX, where X is 0 or 1, "x" in binary numbers means "don't care".

The following typographic expressions are used:

Variables: *variableName* or *variableName[3:0]*, giving only bits 3 to 0 of *variableName*

Range of values: [lowest, highest]

Command: “COMMAND NAME”

DIGITAL ADDRESSABLE LIGHTING INTERFACE –

Part 220: Particular requirements for control gear – Centrally supplied emergency operation (device type 19)

1 Scope

This part of IEC 62386 specifies a bus system for control by digital signals of electronic lighting equipment which is in line with the requirements of IEC 61347 (all parts), with the addition of DC supplies.

This document is applicable to control gear supporting centrally supplied emergency operation as described in EN 50171.

This document does not apply to self-contained emergency lighting control gear. These types of control gear are specified in IEC 62386-202.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 62386-101:2014, *Digital addressable lighting interface – Part 101: General requirements – System components*
IEC 62386-101:2014/AMD1:2018

IEC 62386-102:2014, *Digital addressable lighting interface – Part 102: General requirements – Control devices*
IEC 62386-102:2014/AMD1:2018

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62386-101 and IEC 62386-102 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at http://www.electropedia.org/
- ISO Online browsing platform: available at http://www.iso.org/obp

3.1
emergency level
configurable arc power level for emergency operation

3.2
emergency condition
defined change of state of the supply type or bus power to provoke the emergency operation of control gear

Note 1 to entry: This purely focuses on control gear interfaces. It is not to be confused with the emergency condition signalling occurrence of an emergency event to a central emergency power system.

Note 2 to entry: Change of state is typically controlled by the central power supply system.

3.3
emergency mode
emergency operation, due to the emergency condition being detected

3.4
emergency physical maximum level
emergency level corresponding to the maximum physical light output the control gear can operate at when in emergency mode

Note 1 to entry: The light level in normal mode is not affected by this physical maximum level.

3.5
emergency condition detection time
time starting with the external emergency condition being present and ending with the control gear having detected the emergency condition

3.6
emergency switch and ignition time
time starting with control gear having detected the emergency condition and ending with lamp(s) emitting light

3.7
emergency system failure
ESF
type of emergency condition in which bus power is down

Note 1 to entry: The emergency system failure replaces the system failure where applicable.

Note 2 to entry: This note only applies to the French language.

3.8
emergency transition time
control gear emergency condition detection time plus emergency switch and ignition time

3.9
normal mode
standard operation of a control gear without a detected emergency condition

3.10
supply type
AC supply or DC supply

Note 1 to entry: Supply type for normal and emergency mode may or may not be different.

Note 2 to entry: DC supply is typically realized as continuous DC voltage or pulsed DC voltage (e.g. rectified AC).

4 General

4.1 General

The requirements of IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, Clause 4 apply, with the restrictions, changes and additions identified below.

4.2 Version number

In IEC 62386-102:2014, 4.2, “102” shall be replaced by “220”, “version number” shall be replaced by “extended version number” and the current version number shall be replaced by "*extendedVersionNumber*".

4.3 External power supply of bus units

A control gear according to this document shall not be bus powered.

4.4 Power interruption at bus units

4.4.1 General

The requirements of IEC 62386-101:2014 and IEC 62386-101:2014/AMD1:2018, 4.11 apply, with the following changes and additions.

4.4.2 Power interruptions of external power supply

For control gear with *“deviceType”* = 19, interruptions of external power supply shall be defined as the period of time beginning with failure of normal supply and ending with fully re-established normal supply. This definition applies regardless whether there has been any emergency supply detected in the meantime. Figure 2 shows an example of an external power interruption.

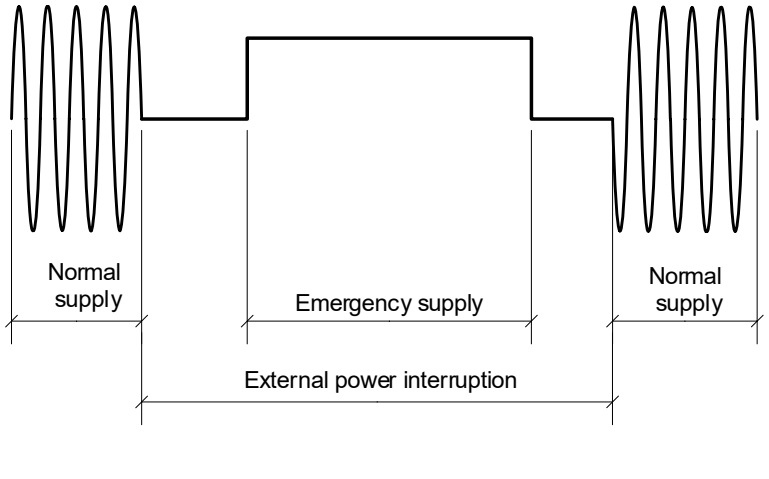


Figure 2 – Example of an external power interruption

5 Electrical specification

5.1 General

The requirements of IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, Clause 5 apply, with the following additions.

5.2 Marking of the supply interface

If the detection of DC supply is polarity sensitive, the external power supply terminals shall be marked with "+" and "–" to indicate the polarity. If colour coding is used, the colours representing the "+" and "–" shall be given on the label.

6 Interface power supply

The requirements of IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, Clause 6, apply.

7 Transmission protocol structure

The requirements of IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, Clause 7, apply.

8 Timing

The requirements of IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, Clause 8, apply.

9 Method of operation

9.1 General

The requirements of IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, Clause 9 apply, with the following restrictions, changes and additions.

9.2 Purpose of control gear in central emergency system

Control gear according to this document are only one component within a centralized emergency power system, and therefore do only partly contribute to the overall central emergency system functionality. Consequently this document focuses solely on functionality realized within the control gear. See Annex A for more information.

NOTE This “part contribution” differs fundamentally from self-contained emergency control gear, where the whole emergency lighting functionality is realized within the control gear.

9.3 Emergency operation light output and emergency level

“emergencyLevel” shall comply with the dimming curve given in IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, 9.3 whereas *“actualLevel”* shall be replaced by *“emergencyLevel”*. The light output at any percentage when *”emergencyMode“* is TRUE shall be the same as at the corresponding percentage in normal mode.

NOTE The default dimming curve is given in IEC 62386-102:2014 and IEC 62386-102:2014/AMD1:2018, 9.3.

9.4 Detection of supply type

The control gear shall provide means for detecting AC and DC supply.

9.5 Emergency condition

Whether to operate in emergency mode or normal mode shall be derived from:

- supply type, or
- bus power down.

The *“emergencyCondition”* variable determines which condition is used to set or clear the emergency mode. See Table 1.