IEC TR 60919-1

Edition 4.0 2020-04

REDLINE VERSION

colour inside

Performance of high-voltage direct current (HVDC) systems with line-commutated converters – Part 1: Steady-state conditions

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ICS 29.200; 29.240.99

ISBN 978-2-8322-8226-7

Warning! Make sure that you obtained this publication from an authorized distributor.

® Registered trademark of the International Electrotechnical Commission

CONTENTS

FOREWORD 8
INTRODUCTION 2
1 Scope 11
2 Normative references 12
3 Terms and definitions 12
4 Types of HVDC systems 12
4.1 General 12
4.2 HVDC back-to-back system 13
4.3 Monopolar HVDC system with earth return ~~HVDC system~~ 13
4.4 Monopolar HVDC system with metallic return ~~HVDC system~~ 17
4.5 Bipolar earth return HVDC system 18
4.6 Bipolar HVDC system with metallic return ~~HVDC system~~ 21
4.7 Two 12-pulse groups per pole 22
4.8 Converter transformer arrangements 25
4.9 DC switching considerations 26
4.10 Series-capacitor-compensated HVDC systems 29
4.11 LCC/VSC hybrid bipolar system 33
5 Environment information 34
6 Rated power, current and voltage 37
6.1 Rated power 37
6.1.1 General 37
6.1.2 Rated power of an HVDC system with transmission line 37
6.1.3 Rated power of an HVDC back-to-back system 37
6.1.4 Direction of power flow 37
6.2 Rated current 37
6.3 Rated voltage 38
7 Overload and equipment capability 38
7.1 Overload 38
7.2 Equipment capability 39
7.2.1 General 39
7.2.2 Converter valve capability 39
7.2.3 Capability of oil-cooled transformers and reactors 39
7.2.4 AC harmonic filter and reactive power compensation equipment capability 40
7.2.5 Switchgear and buswork capability 40
8 Minimum power transfer and no-load stand-by state 40
8.1 General 40
8.2 Minimum current 40
8.3 Reduced direct voltage operation 40
8.4 No-load stand-by state 41
8.4.1 General 41
8.4.2 Converter transformers – No-load stand-by 41
8.4.3 Converter valves – No-load stand-by 41
8.4.4 AC filters and reactive compensation – No-load stand-by 41
8.4.5 DC reactors and DC filters – No-load stand-by 42

8.4.6 Auxiliary power system – No-load stand-by 42
8.4.7 Control and protection – No-load stand-by 42
9 AC system 42
9.1 General 42
9.2 AC voltage 42
9.2.1 Rated AC voltage 42
9.2.2 Steady-state voltage range 42
9.2.3 Negative sequence voltage 43
9.3 Frequency 43
9.3.1 Rated frequency 43
9.3.2 Steady-state frequency range 43
9.3.3 Short-term frequency variation 43
9.3.4 Frequency variation during emergency 44
9.4 System impedance at fundamental frequency 44
9.5 System impedance at harmonic frequencies 44
9.6 Positive and zero-sequence surge impedance 44
9.7 Other sources of harmonics 44
9.8 Subsynchronous torsional interaction (SSTI) 44
10 Reactive power 45
10.1 General 45
10.2 Conventional HVDC systems 45
10.3 Series capacitor compensated HVDC schemes 47
10.4 Converter reactive power consumption 47
10.5 Reactive power balance with the AC system 47
10.6 Reactive power supply 47
10.7 Maximum size of switchable VAR banks 48
11 HVDC transmission line, earth electrode line and earth electrode 48
11.1 General 48
11.2 Overhead line(s) 48
11.2.1 General 48
11.2.2 Electrical parameters 48
11.3 Cable line(s) 49
11.3.1 General 49
11.3.2 Electrical parameters 49
11.4 Earth electrode line 50
11.5 Earth electrode 50
12 Reliability 50
12.1 General 50
12.2 Outage 50
12.2.1 General 50
12.2.2 Scheduled outage 50
12.2.3 Forced outage 50
12.3 Capacity 51
12.3.1 General 51
12.3.2 Maximum continuous capacity P_{m} 51
12.3.3 Outage capacity P_{o} 51
12.3.4 Outage derating factor (ODF) 51
12.4 Outage duration terms 51

12.4.1 Actual outage duration (AOD) 51
12.4.2 Equivalent outage duration (EOD) 51
12.4.3 Period hours (PH) 51
12.4.4 Actual outage hours (AOH) 52
12.4.5 Equivalent outage hours (EOH) 52
12.5 Energy unavailability (EU) 52
12.5.1 General 52
12.5.2 Forced energy unavailability (FEU) 53
12.5.3 Scheduled energy unavailability (SEU) 53
12.6 Energy availability (EA) 53
12.7 Maximum permitted number of forced outages 53
12.8 Statistical probability of outages 53
12.8.1 Component faults 53
12.8.2 External faults 53
13 HVDC control 54
13.1 Control objectives 54
13.2 Control structure 54
13.2.1 General 54
13.2.2 Converter unit firing control 54
13.2.3 Pole control 55
13.2.4 HVDC substation control 58
13.2.5 Master control 60
13.3 Control order settings 60
13.4 Current limits 60
13.5 Control circuit redundancy 61
13.6 Protection system 61
13.7 Measurements 61
14 Telecommunication 62
14.1 Types of telecommunication links 62
14.2 Telephone 62
14.3 Power line carrier (PLC) 62
14.4 Microwave 63
14.5 Radio link 63
14.6 Optical fibre telecommunication 63
14.7 Classification of data to be transmitted 63
14.8 Fast response telecommunication 64
14.9 Reliability 64
15 Auxiliary power supplies 65
15.1 General 65
15.2 Reliability and load classification 65
15.3 AC auxiliary supplies 66
15.4 Batteries and uninterruptible power supplies (UPS) 66
15.5 Emergency supply 67
16 Audible noise 67
16.1 General 67
16.2 Public nuisance 67
16.2.1 General 67
16.2.2 Valves and valve coolers 68

16.2.3 Converter transformers 68
16.2.4 DC reactors 68
16.2.5 AC filter reactors 68
16.3 Noise in working areas 68
17 Harmonic interference – AC 69
17.1 AC side harmonic generation 69
17.2 Filters 69
17.3 Interference disturbance criteria 72
17.4 Levels for interference 73
17.5 Filter performance 74
18 Harmonic interference – DC 74
18.1 DC side interference 74
18.1.1 Harmonic currents in HVDC transmission line 74
18.1.2 Characteristic and non-characteristic harmonics 74
18.1.3 Groups of harmonics 75
18.1.4 Calculation of harmonic currents 75
18.1.5 Calculation of induced voltages 75
18.1.6 Personnel safety 75
18.1.7 DC filters 75
18.2 DC filter performance 76
18.2.1 Requirements for voice communication circuits 76
18.2.2 Levels of interference 76
18.2.3 Safety 76
18.3 Specification requirements 77
18.3.1 Economic level of filtering 77
18.3.2 General criteria 78
18.3.3 Factors to be taken into account for calculations 78
18.3.4 Calculation of currents 79
19 Power line carrier interference (PLC) 80
19.1 General 80
19.2 Performance specification 81
20 Radio frequency interference 82
20.1 General 84
20.2 RFI from HVDC systems 84
20.2.1 RFI sources 84
20.2.2 RFI propagation 85
20.2.3 RFI characteristics 85
20.3 RFI performance specification 86
20.3.1 RFI risk assessment 86
20.3.2 Specification RFI limit and its verification 86
20.3.3 Design aspects 87
21 Power losses 82
21.1 General 87
21.2 Main contributing sources 88
21.2.1 General 88
21.2.2 AC filters and reactive power compensation 88
21.2.3 Converter bridges 88
21.2.4 Converter transformer 88

21.2.5 DC reactor 88
21.2.6 DC filter 88
21.2.7 Auxiliary equipment 89
21.2.8 Other components 89
22 Provision for extensions to the HVDC systems 89
22.1 General 89
22.2 Specification for extensions 89
Annex A (informative) Factors affecting reliability and availability of converter stations 92
A.1 Design and documentation 92
A.1.1 General 92
A.1.2 General design principles 92
A.1.3 More detailed design principles 93
A.1.4 Software design principles 93
A.1.5 RAM records 94
A.2 Operation 94
A.2.1 Training 94
A.2.2 Maintenance programs affecting reliability 95
A.2.3 Spare parts 96
Bibliography 99

Figure 1 – Twelve-pulse converter unit 11
Figure 2 – Examples of back-to-back HVDC systems 14
Figure 3 – Monopolar HVDC system with earth return 15
Figure 4 – Two 12-pulse units in series 16
Figure 5 – Two 12-pulse units in parallel 17
Figure 6 – Monopolar HVDC system with metallic return ~~system~~ 18
Figure 7 – Bipolar system 19
Figure 8 – Metallic return operation of the unfaulted pole in a bipolar system 20
Figure 9 – Bipolar ~~metallic return~~ HVDC system with metallic return 22
Figure 10 – Bipolar system with two 12-pulse units in series per pole 24
Figure 11 – Bipolar system with two 12-pulse units in parallel per pole 25
Figure 12 – DC switching of line conductors 27
Figure 13 – DC switching of converter poles 28
Figure 14 – DC switching – Overhead line to cable 29
Figure 15 – DC switching – Two bipolar converters and lines 30
Figure 16 – DC switching – Intermediate 31
Figure 17 – Capacitor commutated converter configurations 32
Figure 18 – LCC/VSC hybrid bipolar system 34
Figure 19 – Variations of reactive power Q with active power P of an HVDC converter 46
Figure 20 – Control hierarchy for HVDC/UHVDC system 57
Figure 21 – Converter voltage-current characteristic 59
Figure 22 – Examples of AC filter connections for a bipole HVDC system 70
Figure 23 – Circuit diagrams for different filter types 71
Figure 24 – RY COM ~~noise~~ interference meter results averaged – Typical plot of converter ~~noise~~ interference levels on the DC line ~~corrected and normalized to 3 kHz bandwidth – 0 dBm = 0,775 V~~ 82

Figure 25 – Recommended measurement procedure with definition of measuring point 87
Figure 26 – Extension methods for HVDC systems 91

Table 1 – Information supplied for HVDC substation 35
Table 2 – Performance parameters for voice communication circuits: Subscribers and trunk circuits 77

INTERNATIONAL ELECTROTECHNICAL COMMISSION

_____

PERFORMANCE OF HIGH-VOLTAGE DIRECT CURRENT (HVDC) SYSTEMS WITH LINE-COMMUTATED CONVERTERS –

Part 1: Steady-state conditions

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

DISCLAIMER
This Redline version is not an official Standard and is intended to provide the user with an indication of what changes have been made to the previous version. Only the IEC International Standard provided in this package is to be considered the official Standard.

This Redline version provides you with a quick and easy way to compare all the changes between this standard and its previous edition. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC TR 60919-1, which is a technical report, has been prepared by subcommittee 22F: Power electronics for electrical transmission and distribution systems, of IEC technical committee 22: Power electronic systems and equipment.

This fourth edition cancels and replaces the third edition, published in 2010, Amendment 1:2013 and Amendment 2:2017. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

a) Figure 8 and Figure 20 have been updated, a new Figure 18 "LCC/VSC hybrid bipolar system" has been added;
b) the HVDC system control objectives have been supplemented;
c) additional explanations regarding the HVDC system control structure have been given;
d) a new subclause 13.6 on HVDC system protection has been added.

The text of this Technical Report is based on the following documents:

Draft TR	Report on voting
22F/535/DTR	22F/549A/RVDTR

Full information on the voting for the approval of this Technical Report can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 60919 series, published under the general title *Performance of high-voltage direct current (HVDC) systems with line-commutated converters*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "http://webstore.iec.ch" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

The difference between system performance specifications and equipment design specifications for individual components of a system is realized. Frequently, performance specifications are prepared as a single package for the two HVDC substations in a particular system. Alternatively, some parts of the HVDC system can be separately specified and purchased. In such cases, due consideration ~~should be~~ is given to coordination of each part with the overall HVDC system performance objectives and to ensuring that the interface of each with the system ~~should be~~ is clearly defined. Typical of such parts, listed in the appropriate order of relative ease for separate treatment and interface definition, are:

a) DC line, electrode line and earth electrode;

b) telecommunication system;

c) converter building, foundations and other civil engineering work;

d) reactive power supply including AC shunt capacitor banks, shunt reactors, synchronous and static reactive power (var) compensators;

e) AC switchgear;

f) DC switchgear;

g) auxiliary systems;

h) AC filters;

i) DC filters;

j) DC reactors;

k) converter transformers;

l) surge arresters;

m) series commutation capacitors;

n) valves and their ancillaries;

o) control and protection systems.

NOTE The last four items are the most difficult to separate, and, in fact, separation of these four ~~may~~ can be inadvisable.

Clause 4 to Clause 22 of this document set out a complete steady-state performance specification for an HVDC system ~~should consider Clauses 3 to 21 of this report~~.

~~Terms and definitions for high-voltage direct current (HVDC) transmission used in this report are given in IEC 60633.~~

Since the equipment items are usually separately specified and purchased, the HVDC transmission line, earth electrode line and earth electrode (see Clause 11) are included only because of their influence on the HVDC system performance.


For the purpose of this document, an HVDC substation is assumed to consist of one or more converter units installed in a single location together with buildings, reactors, filters, reactive power supply, control, monitoring, protective, measuring and auxiliary equipment. While there is no discussion of AC switching substations in this document, AC filters and reactive power sources are included, although they ~~may~~ can be connected to an AC bus separate from the HVDC substation, as discussed in Clause 17.

PERFORMANCE OF HIGH-VOLTAGE DIRECT CURRENT (HVDC) SYSTEMS WITH LINE-COMMUTATED CONVERTERS –

Part 1: Steady-state conditions

1 Scope

This part of IEC 60919 provides general guidance on the steady-state performance requirements of high-voltage direct current (HVDC) systems. It concerns the steady-state performance of two-terminal HVDC systems utilizing 12-pulse converter units comprised of three-phase bridge (double-way) connections (see Figure 1), but it does not cover multi-terminal HVDC transmission systems. Both terminals are assumed to use thyristor valves as the main semiconductor valves and to have power flow capability in both directions. Diode valves are not considered in this document.

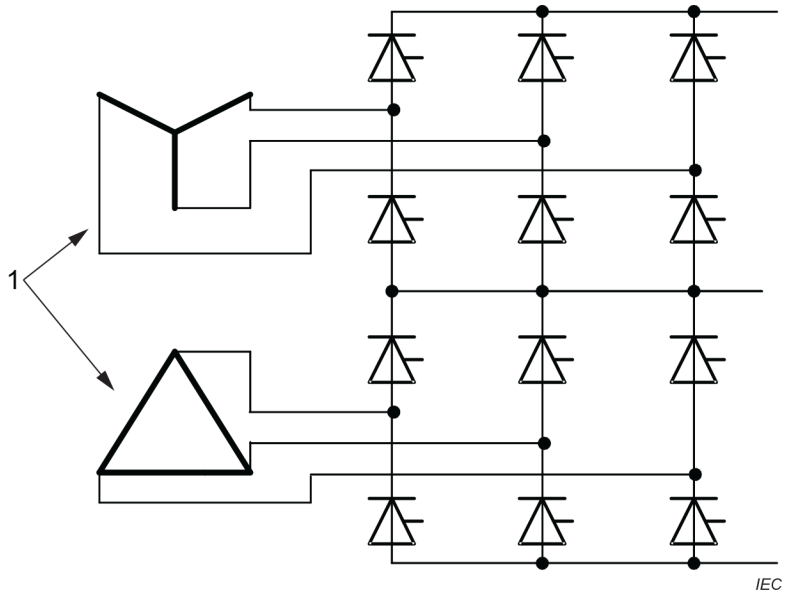

Key

1 Transformer valve windings

Figure 1 – Twelve-pulse converter unit

Only line-commutated converters are covered in this document, which includes capacitor commutated converter circuit configurations. General ~~requirements for~~ aspects of semiconductor line-commutated converters are given in IEC 60146-1-1, IEC TR 60146-1-2 and IEC 60146-1-3. Voltage-sourced converters are not considered.

~~This technical report, which covers steady-state performance, is followed by additional documents on dynamic performance and transient performance. All three aspects should be considered when preparing two-terminal HVDC system specifications.~~

The ~~difference~~ distinction is made between system performance specifications and equipment design specifications for individual components of a system ~~should be realized~~. Equipment specifications and testing requirements are not defined in this document. Also excluded from this document are detailed seismic performance requirements. In addition, because there are many variations between different possible HVDC systems, this document does not consider these in detail; consequently, it ~~should~~ is not ~~be~~ used directly as a specification for a

particular project, but rather to provide the basis for an appropriate specification tailored to fit actual system requirements.

This document, which covers steady-state performance, is followed by the additional documents of IEC TR 60919-2 on faults and switching as well as IEC TR 60919-3 on dynamic conditions. All three aspects are considered when preparing two-terminal HVDC system specifications.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

~~IEC 60146-1-1, *Semiconductor converters – General requirements and line commutated converters – Part 1-1: Specifications of basic requirements*~~

~~IEC/TR 60146-1-2, *Semiconductor convertors – General requirements and line commutated convertors – Part 1-2: Application guide*~~

~~IEC 60146-1-3, *Semiconductor convertors – General requirements and line commutated convertors – Part 1-3: Transformers and reactors*~~

IEC 60633, ~~*Terminology for*~~ *High-voltage direct current (HVDC) transmission – Vocabulary*

CIGRÉ Technical Brochure (TB) No. 391:2009, *Guide for measurement of radio frequency interference from HV and MV substations. Disturbance propagation, characteristics of disturbance sources, measurement techniques, conversion methodologies and limits*

IEC TR 60919-1

Edition 4.0 2020-04

TECHNICAL REPORT

colour inside

Performance of high-voltage direct current (HVDC) systems with line-commutated converters – Part 1: Steady-state conditions



IEC TR 60919-1:2020-04 (en)

CONTENTS

FOREWORD 8
INTRODUCTION 10
1 Scope 11
2 Normative references 12
3 Terms and definitions 12
4 Types of HVDC systems 12
4.1 General 12
4.2 HVDC back-to-back system 12
4.3 Monopolar HVDC system with earth return 13
4.4 Monopolar HVDC system with metallic return 16
4.5 Bipolar earth return HVDC system 17
4.6 Bipolar HVDC system with metallic return 20
4.7 Two 12-pulse groups per pole 21
4.8 Converter transformer arrangements 24
4.9 DC switching considerations 25
4.10 Series-capacitor-compensated HVDC systems 28
4.11 LCC/VSC hybrid bipolar system 32
5 Environment information 33
6 Rated power, current and voltage 36
6.1 Rated power 36
6.1.1 General 36
6.1.2 Rated power of an HVDC system with transmission line 36
6.1.3 Rated power of an HVDC back-to-back system 36
6.1.4 Direction of power flow 37
6.2 Rated current 37
6.3 Rated voltage 37
7 Overload and equipment capability 37
7.1 Overload 37
7.2 Equipment capability 38
7.2.1 General 38
7.2.2 Converter valve capability 38
7.2.3 Capability of oil-cooled transformers and reactors 39
7.2.4 AC harmonic filter and reactive power compensation equipment capability 39
7.2.5 Switchgear and buswork capability 39
8 Minimum power transfer and no-load stand-by state 39
8.1 General 39
8.2 Minimum current 39
8.3 Reduced direct voltage operation 40
8.4 No-load stand-by state 40
8.4.1 General 40
8.4.2 Converter transformers – No-load stand-by 40
8.4.3 Converter valves – No-load stand-by 40
8.4.4 AC filters and reactive compensation – No-load stand-by 41
8.4.5 DC reactors and DC filters – No-load stand-by 41

8.4.6 Auxiliary power system – No-load stand-by 41
8.4.7 Control and protection – No-load stand-by 41
9 AC system 41
9.1 General 41
9.2 AC voltage 41
9.2.1 Rated AC voltage 41
9.2.2 Steady-state voltage range 41
9.2.3 Negative sequence voltage 42
9.3 Frequency 42
9.3.1 Rated frequency 42
9.3.2 Steady-state frequency range 43
9.3.3 Short-term frequency variation 43
9.3.4 Frequency variation during emergency 43
9.4 System impedance at fundamental frequency 43
9.5 System impedance at harmonic frequencies 43
9.6 Positive and zero-sequence surge impedance 43
9.7 Other sources of harmonics 44
9.8 Subsynchronous torsional interaction (SSTI) 44
10 Reactive power 44
10.1 General 44
10.2 Conventional HVDC systems 44
10.3 Series capacitor compensated HVDC schemes 46
10.4 Converter reactive power consumption 46
10.5 Reactive power balance with the AC system 46
10.6 Reactive power supply 46
10.7 Maximum size of switchable VAR banks 47
11 HVDC transmission line, earth electrode line and earth electrode 47
11.1 General 47
11.2 Overhead line(s) 47
11.2.1 General 47
11.2.2 Electrical parameters 47
11.3 Cable line(s) 48
11.3.1 General 48
11.3.2 Electrical parameters 48
11.4 Earth electrode line 49
11.5 Earth electrode 49
12 Reliability 49
12.1 General 49
12.2 Outage 49
12.2.1 General 49
12.2.2 Scheduled outage 49
12.2.3 Forced outage 49
12.3 Capacity 50
12.3.1 General 50
12.3.2 Maximum continuous capacity P_{m} 50
12.3.3 Outage capacity P_{o} 50
12.3.4 Outage derating factor (ODF) 50
12.4 Outage duration terms 50

12.4.1 Actual outage duration (AOD) 50
12.4.2 Equivalent outage duration (EOD) 50
12.4.3 Period hours (PH) 50
12.4.4 Actual outage hours (AOH) 51
12.4.5 Equivalent outage hours (EOH) 51
12.5 Energy unavailability (EU) 51
12.5.1 General 51
12.5.2 Forced energy unavailability (FEU) 51
12.5.3 Scheduled energy unavailability (SEU) 52
12.6 Energy availability (EA) 52
12.7 Maximum permitted number of forced outages 52
12.8 Statistical probability of outages 52
12.8.1 Component faults 52
12.8.2 External faults 52
13 HVDC control 52
13.1 Control objectives 52
13.2 Control structure 53
13.2.1 General 53
13.2.2 Converter unit firing control 53
13.2.3 Pole control 54
13.2.4 HVDC substation control 56
13.2.5 Master control 58
13.3 Control order settings 58
13.4 Current limits 58
13.5 Control circuit redundancy 59
13.6 Protection system 59
13.7 Measurements 59
14 Telecommunication 60
14.1 Types of telecommunication links 60
14.2 Telephone 60
14.3 Power line carrier (PLC) 60
14.4 Microwave 61
14.5 Radio link 61
14.6 Optical fibre telecommunication 61
14.7 Classification of data to be transmitted 61
14.8 Fast response telecommunication 62
14.9 Reliability 62
15 Auxiliary power supplies 63
15.1 General 63
15.2 Reliability and load classification 63
15.3 AC auxiliary supplies 64
15.4 Batteries and uninterruptible power supplies (UPS) 64
15.5 Emergency supply 65
16 Audible noise 65
16.1 General 65
16.2 Public nuisance 65
16.2.1 General 65
16.2.2 Valves and valve coolers 66

16.2.3 Converter transformers 66
16.2.4 DC reactors 66
16.2.5 AC filter reactors 66
16.3 Noise in working areas 66
17 Harmonic interference – AC 67
17.1 AC side harmonic generation 67
17.2 Filters 67
17.3 Interference disturbance criteria 70
17.4 Levels for interference 71
17.5 Filter performance 72
18 Harmonic interference – DC 72
18.1 DC side interference 72
18.1.1 Harmonic currents in HVDC transmission line 72
18.1.2 Characteristic and non-characteristic harmonics 72
18.1.3 Groups of harmonics 73
18.1.4 Calculation of harmonic currents 73
18.1.5 Calculation of induced voltages 73
18.1.6 Personnel safety 73
18.1.7 DC filters 73
18.2 DC filter performance 74
18.2.1 Requirements for voice communication circuits 74
18.2.2 Levels of interference 74
18.2.3 Safety 74
18.3 Specification requirements 75
18.3.1 Economic level of filtering 75
18.3.2 General criteria 76
18.3.3 Factors to be taken into account for calculations 76
18.3.4 Calculation of currents 77
19 Power line carrier interference (PLC) 77
19.1 General 77
19.2 Performance specification 78
20 Radio frequency interference 79
20.1 General 79
20.2 RFI from HVDC systems 80
20.2.1 RFI sources 80
20.2.2 RFI propagation 80
20.2.3 RFI characteristics 80
20.3 RFI performance specification 81
20.3.1 RFI risk assessment 81
20.3.2 Specification RFI limit and its verification 81
20.3.3 Design aspects 82
21 Power losses 82
21.1 General 82
21.2 Main contributing sources 83
21.2.1 General 83
21.2.2 AC filters and reactive power compensation 83
21.2.3 Converter bridges 83
21.2.4 Converter transformer 83

21.2.5 DC reactor 83
21.2.6 DC filter 84
21.2.7 Auxiliary equipment 84
21.2.8 Other components 84
22 Provision for extensions to the HVDC systems 84
22.1 General 84
22.2 Specification for extensions 84
Annex A (informative) Factors affecting reliability and availability of converter stations 87
A.1 Design and documentation 87
A.1.1 General 87
A.1.2 General design principles 87
A.1.3 More detailed design principles 88
A.1.4 Software design principles 88
A.1.5 RAM records 89
A.2 Operation 89
A.2.1 Training 89
A.2.2 Maintenance programs affecting reliability 90
A.2.3 Spare parts 91
Bibliography 94

Figure 1 – Twelve-pulse converter unit 11
Figure 2 – Examples of back-to-back HVDC systems 13
Figure 3 – Monopolar HVDC system with earth return 14
Figure 4 – Two 12-pulse units in series 15
Figure 5 – Two 12-pulse units in parallel 16
Figure 6 – Monopolar HVDC system with metallic return 17
Figure 7 – Bipolar system 18
Figure 8 – Metallic return operation of the unfaulted pole in a bipolar system 19
Figure 9 – Bipolar HVDC system with metallic return 21
Figure 10 – Bipolar system with two 12-pulse units in series per pole 23
Figure 11 – Bipolar system with two 12-pulse units in parallel per pole 24
Figure 12 – DC switching of line conductors 26
Figure 13 – DC switching of converter poles 27
Figure 14 – DC switching – Overhead line to cable 28
Figure 15 – DC switching – Two bipolar converters and lines 29
Figure 16 – DC switching – Intermediate 30
Figure 17 – Capacitor commutated converter configurations 31
Figure 18 – LCC/VSC hybrid bipolar system 33
Figure 19 – Variations of reactive power Q with active power P of an HVDC converter 45
Figure 20 – Control hierarchy for HVDC/UHVDC system 55
Figure 21 – Converter voltage-current characteristic 57
Figure 22 – Examples of AC filter connections for a bipole HVDC system 68
Figure 23 – Circuit diagrams for different filter types 69
Figure 24 – RY COM interference meter results averaged – Typical plot of converter interference levels on the DC line 79

Figure 25 – Recommended measurement procedure with definition of measuring point 82
Figure 26 – Extension methods for HVDC systems 86

Table 1 – Information supplied for HVDC substation 34
Table 2 – Performance parameters for voice communication circuits: Subscribers and trunk circuits 75

INTERNATIONAL ELECTROTECHNICAL COMMISSION

_____

PERFORMANCE OF HIGH-VOLTAGE DIRECT CURRENT (HVDC) SYSTEMS WITH LINE-COMMUTATED CONVERTERS –

Part 1: Steady-state conditions

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC TR 60919-1, which is a technical report, has been prepared by subcommittee 22F: Power electronics for electrical transmission and distribution systems, of IEC technical committee 22: Power electronic systems and equipment.

This fourth edition cancels and replaces the third edition, published in 2010, Amendment 1:2013 and Amendment 2:2017. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

a) Figure 8 and Figure 20 have been updated, a new Figure 18 "LCC/VSC hybrid bipolar system" has been added;
b) the HVDC system control objectives have been supplemented;
c) additional explanations regarding the HVDC system control structure have been given;
d) a new subclause 13.6 on HVDC system protection has been added.

The text of this Technical Report is based on the following documents:

Draft TR	Report on voting
22F/535/DTR	22F/549A/RVDTR

Full information on the voting for the approval of this Technical Report can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 60919 series, published under the general title *Performance of high-voltage direct current (HVDC) systems with line-commutated converters*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "http://webstore.iec.ch" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

The difference between system performance specifications and equipment design specifications for individual components of a system is realized. Frequently, performance specifications are prepared as a single package for the two HVDC substations in a particular system. Alternatively, some parts of the HVDC system can be separately specified and purchased. In such cases, due consideration is given to coordination of each part with the overall HVDC system performance objectives and to ensuring that the interface of each with the system is clearly defined. Typical of such parts, listed in the appropriate order of relative ease for separate treatment and interface definition, are:

a) DC line, electrode line and earth electrode;

b) telecommunication system;

c) converter building, foundations and other civil engineering work;

d) reactive power supply including AC shunt capacitor banks, shunt reactors, synchronous and static reactive power (var) compensators;

e) AC switchgear;

f) DC switchgear;

g) auxiliary systems;

h) AC filters;

i) DC filters;

j) DC reactors;

k) converter transformers;

l) surge arresters;

m) series commutation capacitors;

n) valves and their ancillaries;

o) control and protection systems.

NOTE The last four items are the most difficult to separate, and, in fact, separation of these four can be inadvisable.

Clause 4 to Clause 22 of this document set out a complete steady-state performance specification for an HVDC system.

Since the equipment items are usually separately specified and purchased, the HVDC transmission line, earth electrode line and earth electrode (see Clause 11) are included only because of their influence on the HVDC system performance.


For the purpose of this document, an HVDC substation is assumed to consist of one or more converter units installed in a single location together with buildings, reactors, filters, reactive power supply, control, monitoring, protective, measuring and auxiliary equipment. While there is no discussion of AC switching substations in this document, AC filters and reactive power sources are included, although they can be connected to an AC bus separate from the HVDC substation, as discussed in Clause 17.

PERFORMANCE OF HIGH-VOLTAGE DIRECT CURRENT (HVDC) SYSTEMS WITH LINE-COMMUTATED CONVERTERS –

Part 1: Steady-state conditions

1 Scope

This part of IEC 60919 provides general guidance on the steady-state performance requirements of high-voltage direct current (HVDC) systems. It concerns the steady-state performance of two-terminal HVDC systems utilizing 12-pulse converter units comprised of three-phase bridge (double-way) connections (see Figure 1), but it does not cover multi-terminal HVDC transmission systems. Both terminals are assumed to use thyristor valves as the main semiconductor valves and to have power flow capability in both directions. Diode valves are not considered in this document.

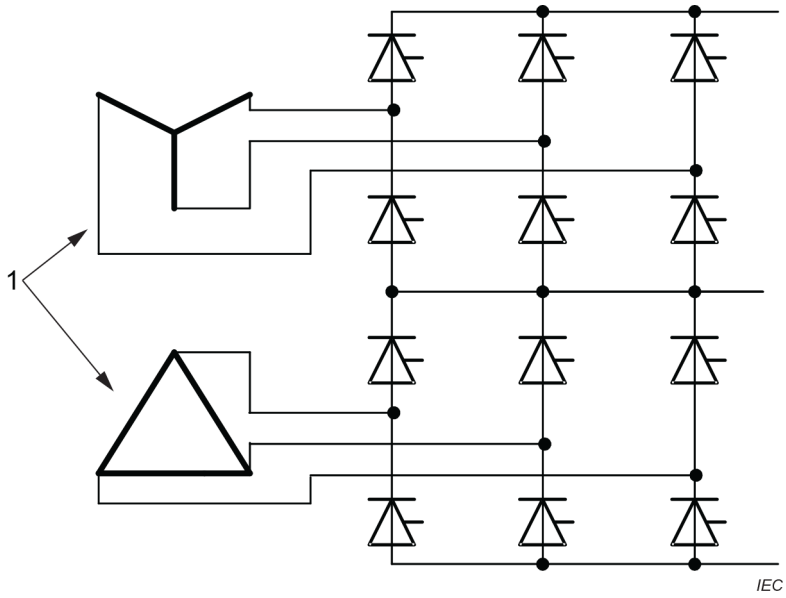

Key

1 Transformer valve windings

Figure 1 – Twelve-pulse converter unit

Only line-commutated converters are covered in this document, which includes capacitor commutated converter circuit configurations. General aspects of semiconductor line-commutated converters are given in IEC 60146-1-1, IEC TR 60146-1-2 and IEC 60146-1-3. Voltage-sourced converters are not considered.

The distinction is made between system performance specifications and equipment design specifications for individual components of a system. Equipment specifications and testing requirements are not defined in this document. Also excluded from this document are detailed seismic performance requirements. In addition, because there are many variations between different possible HVDC systems, this document does not consider these in detail; consequently, it is not used directly as a specification for a particular project, but rather to provide the basis for an appropriate specification tailored to fit actual system requirements.

This document, which covers steady-state performance, is followed by the additional documents of IEC TR 60919-2 on faults and switching as well as IEC TR 60919-3 on dynamic

conditions. All three aspects are considered when preparing two-terminal HVDC system specifications.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60633, *High-voltage direct current (HVDC) transmission – Vocabulary*

CIGRÉ Technical Brochure (TB) No. 391:2009, *Guide for measurement of radio frequency interference from HV and MV substations. Disturbance propagation, characteristics of disturbance sources, measurement techniques, conversion methodologies and limits*